


Item	Description
1	Aerona ³ ASHP
2	Flexible hose
3	Isolation valve
4	Flow setter (supplied with Aerona ³ ASHP) <i>refer to Aerona³ heat pump installation instructions to calculate required flow rate</i>
5	Grant Mag One magnetic filter*
6	3-Port diverter valve*
7	Grant combined volumiser / low loss header*
8	Auxiliary backup heater (3kW immersion)*
9	Manual air vent*
10	Drain point*
11	Removable filling loop*
12	Double check valve*
13	Pressure gauge*
14	Expansion vessel*
15	Pressure relief valve*
16	Tundish*
17	Additional circulating pump
18	Automatic system bypass
19	Motorized 2-Port valve (UFH circuit)
20	Thermostatic mixing valve
21	UFH pump
22	UFH manifold
23	Grant UH8 wiring centre
24	Room thermostat (Grant NeoStat or Edge)
25	Thermostatic radiator valve
26	Motorized 2-Port valve (radiator circuit)
27	Automatic air vent
28	Immersion heater programmer*
29	Cylinder immersion heater
30	DHW sensor*
31	DHW cylinder
32	Grant DHW timer (HPIDTM4)*
33	Wiring centre
34	Grant Hot Water Priority Relay*
35	Grant EP002 ASHP interface
36	ASHP remote controller (supplied with Aerona ³ ASHP)

* Supplied with HPIDR32PACKC

The length and number of DHW 'on' periods are critical to ensure satisfactory performance of the heating system. Refer to the Aerona³ heat pump installation instructions for more information.

The siting of room thermostats is critical to ensure satisfactory performance of the heating system. Refer to the Aerona³ heat pump installation instructions for more information.

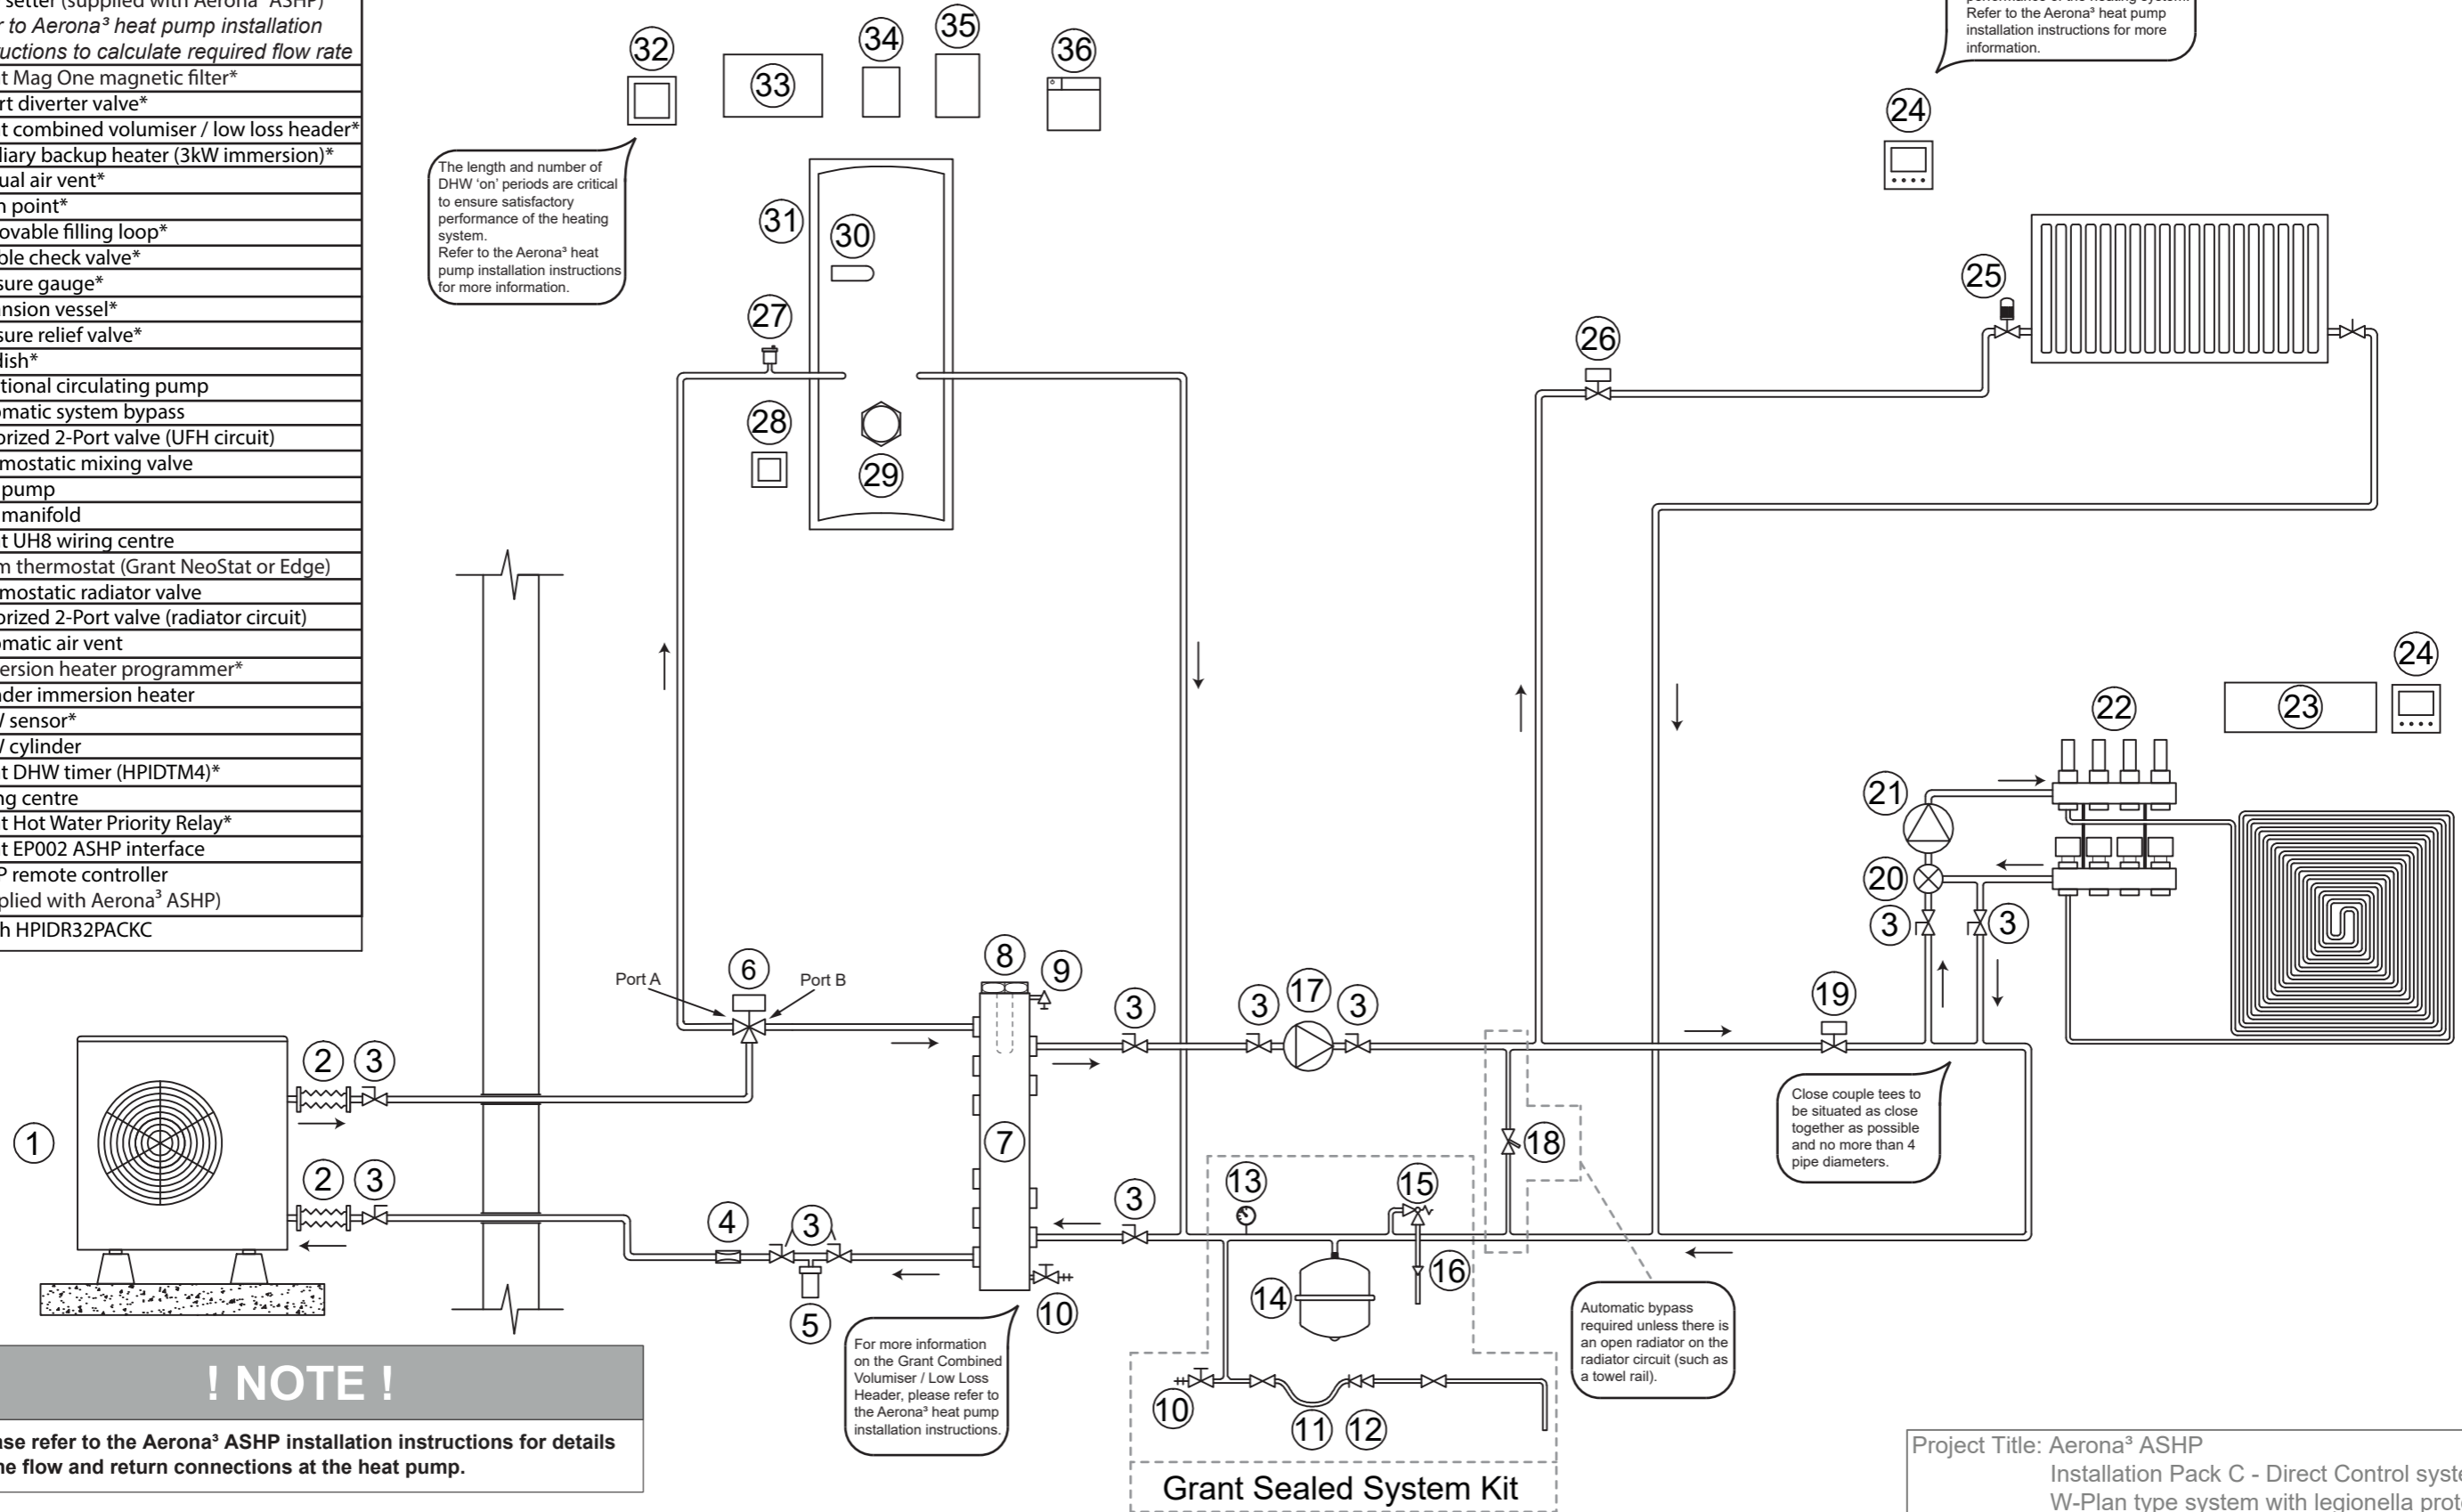

! NOTE !
Please refer to the Aerona³ ASHP installation instructions for details of the flow and return connections at the heat pump.

! NOTE !
This system schematic should be read in conjunction with the Aerona³ ASHP installation instructions and wiring diagram HPCS-C001E.

Project Title: Aerona ³ ASHP Installation Pack C - Direct Control system W-Plan type system with legionella protection UFH downstairs and radiators upstairs HW priority provided by Aerona ³ ASHP controller (system schematic)	
Drawing Set: Aerona ³ Control System Schematics	Dwg. No: HPCS-C001S
Status: Approved	Revision: 1.0
Rev Date: 25/01/22 Drawn By: CG	Checked By: NS & PS
<small>This drawing and its content is subject to copyright. Use other than for its original intended purpose must be arranged with an employee of Grant UK Ltd. Hopton House, Hopton Industrial Estate, Devizes, Wiltshire, SN10 2EU, tel: 01380 736920</small>	