



Item	Description
1	Aerona ³ ASHP
2	Flexible hoses & Isolation Valves ¹
3	Isolation valve
4	Grant Volumiser or Low Loss Header***(optional)
5	Anti-Vibration Mounts ²
6	Flow sensor ¹
7	Grant Mag One magnetic filter kit ²
8	Wiring Centre ¹
9	Touchscreen display ¹
10	Room thermostat (Optional)
11	Motorized 2-Port valve (DHW)
12	Automatic air vent
13	Cylinder immersion heater
14	DHW cylinder
15	Immersion heater relay ²
16	Drain point
17	Removable filling loop ²
18	Double check valve ²
19	Pressure gauge ²
20	Expansion vessel ²
21	Tundish
22	Pressure relief valve ²
23	Automatic bypass
24	Thermostatic Radiator valve
25	Motorized 2-Port valve (Radiators - Upstairs)
26	Motorized 2-Port valve (Radiators - Downstairs)
27	Water temperature sensor ¹
28	Outdoor weather sensor ¹
¹ Supplied with the HPIDR32SMART* Smart Controller Kit	
*Outputs available: 6, 10, 13 & 17 kW	
² Supplied with the HPIDR32PACKP	



****Compression elbow c/w air vent**
(supplied with HPIDVOL30EXT6)

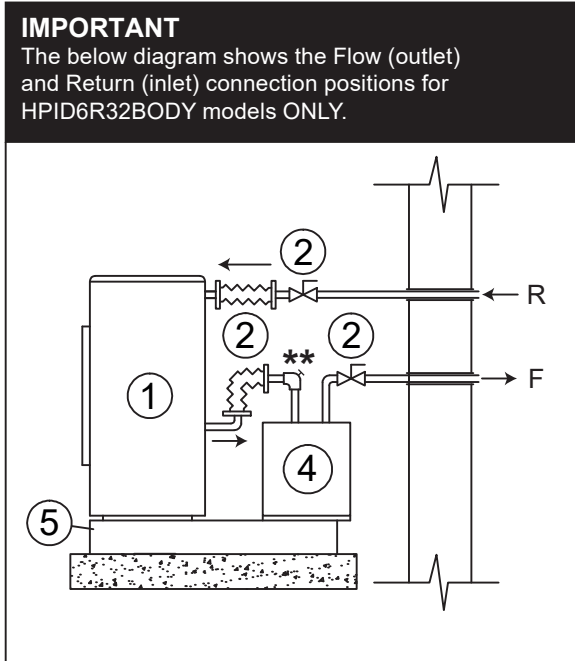

Scale: NTS
Paper Size: A3

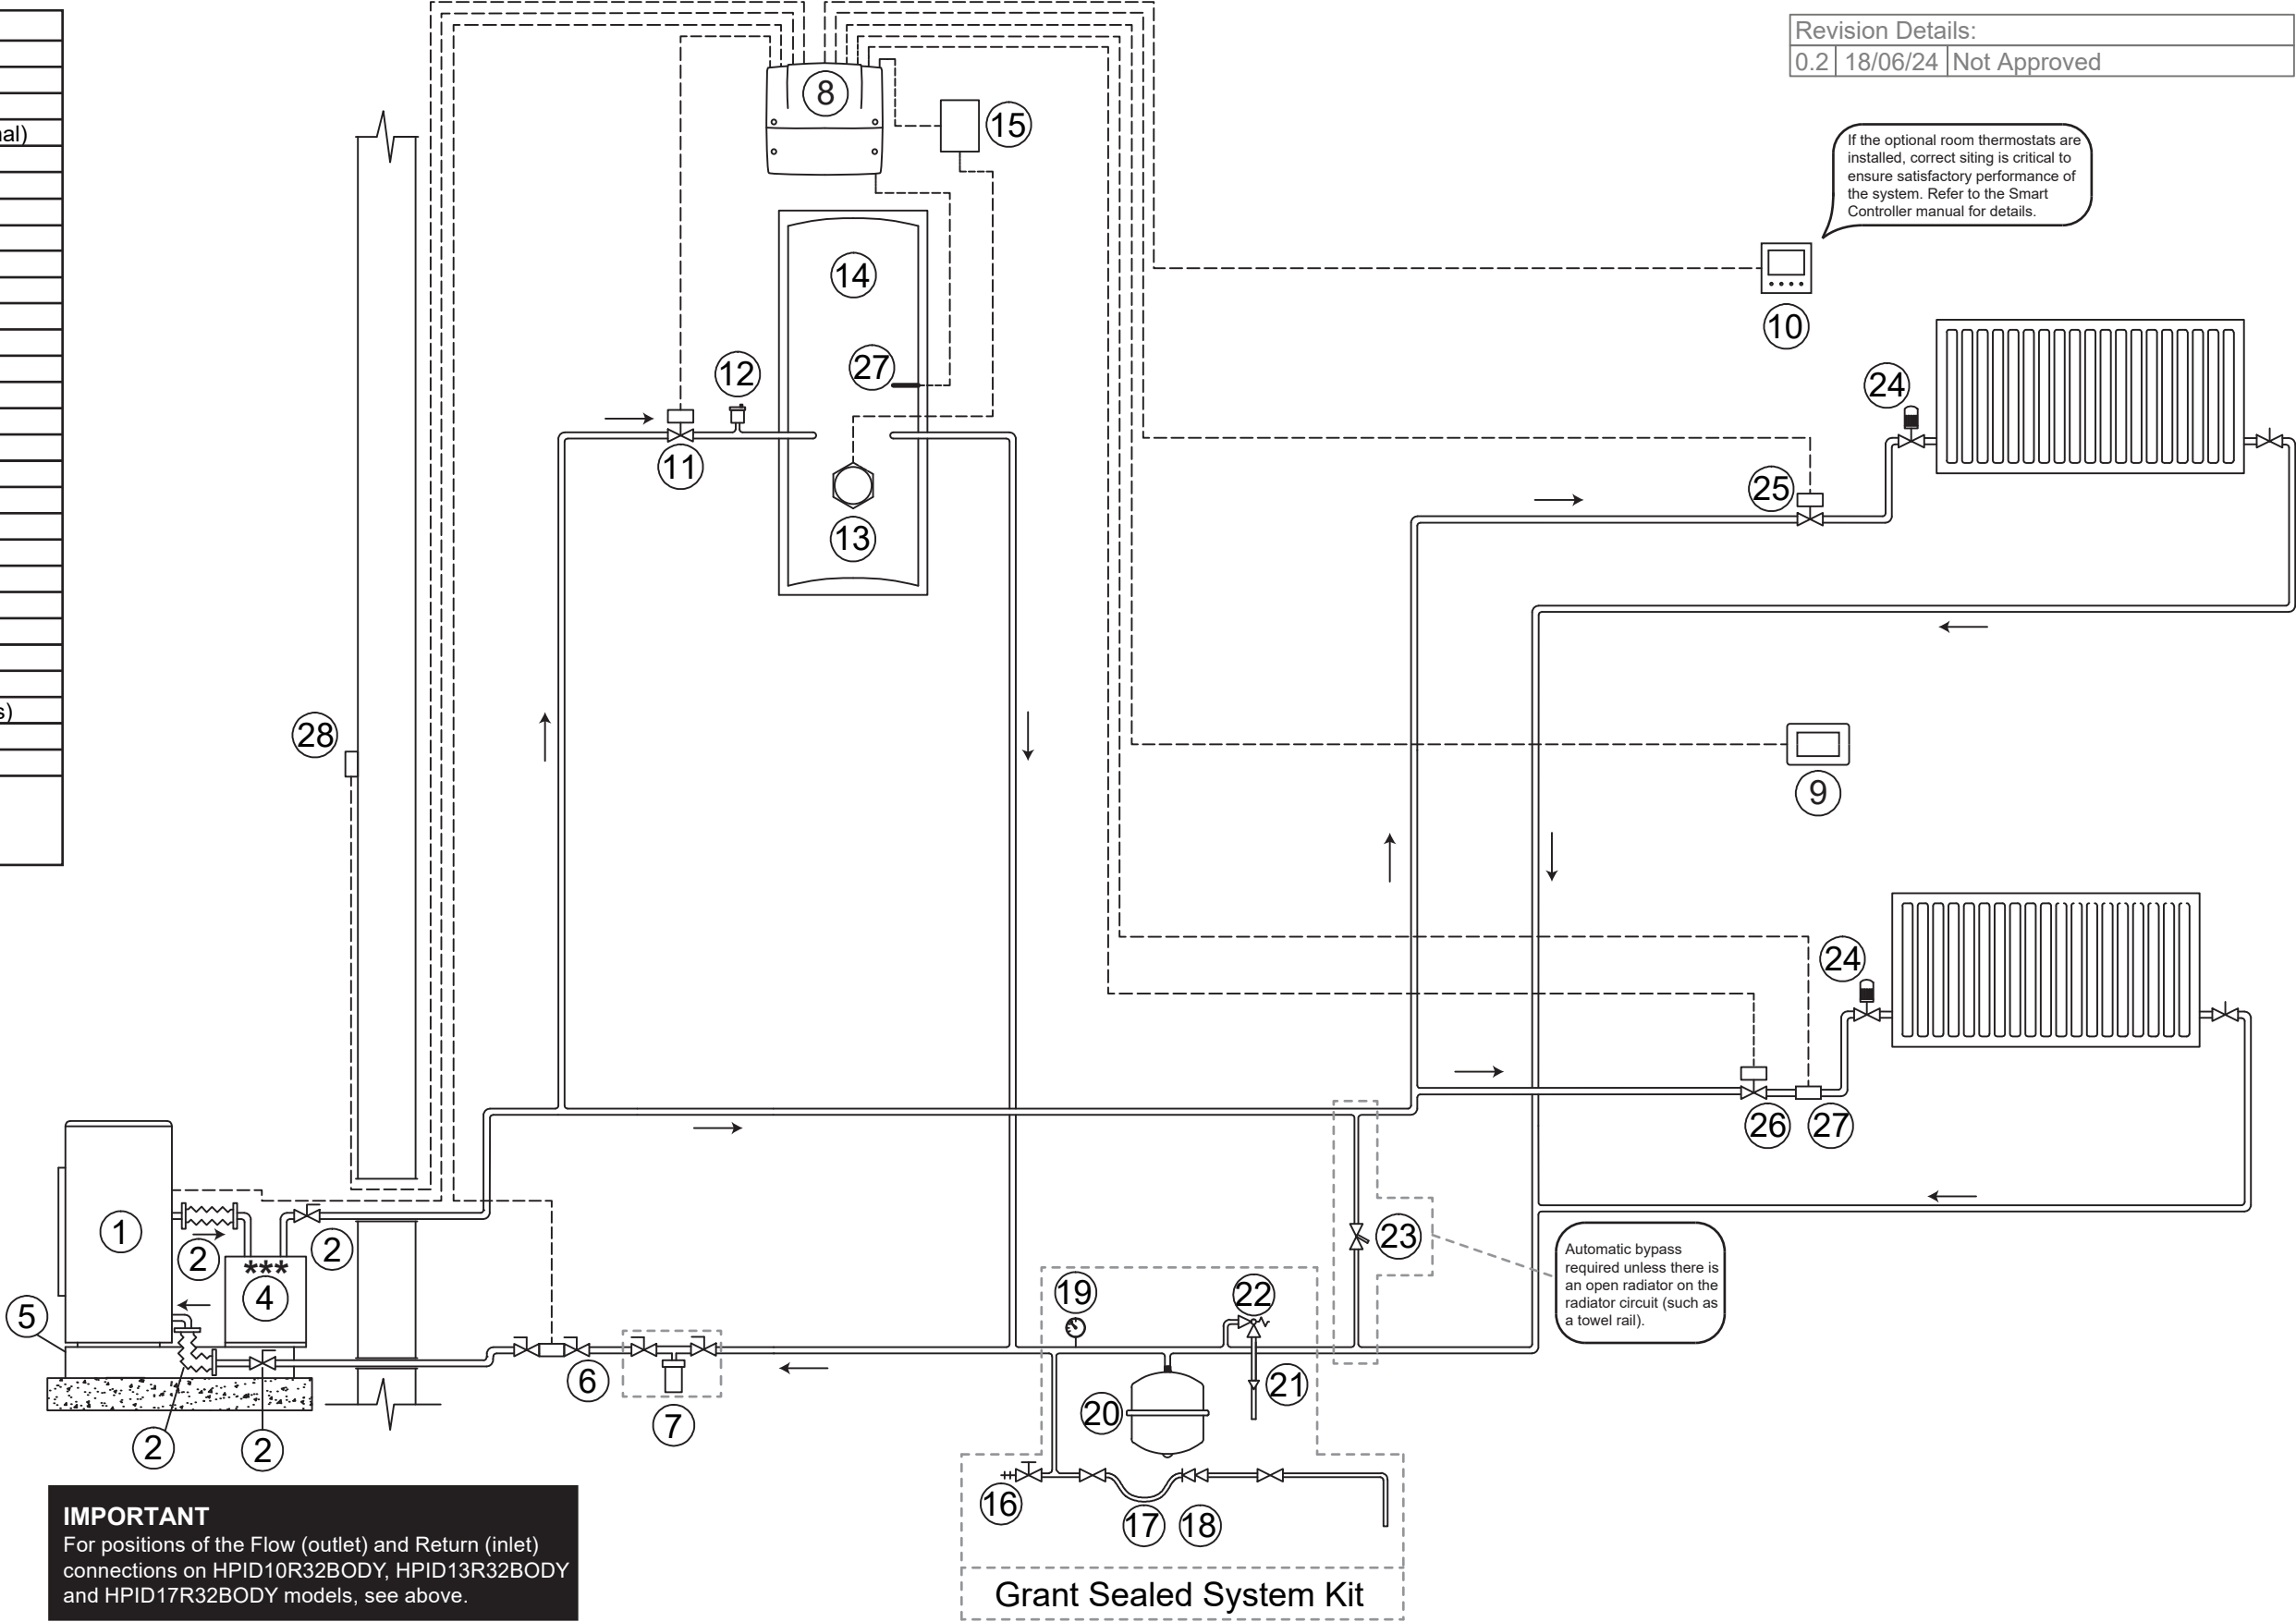

IMPORTANT
For positions of the Flow (outlet) and Return (inlet) connections on HPID10R32BODY, HPID13R32BODY and HPID17R32BODY models, see above.

! NOTE!
***30L external volumiser is available as an optional component where there is insufficient system volume (HPIDVOLEXT30).

! NOTE!
Please refer to the Aerona³ ASHP installation instructions for details of the flow and return connections at the heat pump.

! NOTE!
For additional heater support from Grant External Volumiser, Refer to Grant Aerona Smart Controller installation manual and schematics HPSC-BUHS and HPSC-BUHE.

! NOTE!
This system schematic should be read in conjunction with the Grant Aerona Smart Controller installation instructions and wiring diagram HPCS-P005ER32.

Project Title: Grant Aerona Smart Controls Installation Pack P S-Plan Plus type system with legionella protection Radiators Downstairs & Upstairs HW priority & Legionella Protection from wiring centre (System schematic)	
Drawing Set: Aerona Smart Control System Schematics	Dwg. No: HPCS-P005SR32
Status: Approved	Revision: 0.2
Rev Date: 21/06/24	Drawn By: AC&DB
Checked By: NS	
<small>This drawing and its content is subject to copyright. Use other than for its original intended purpose must be arranged with an employee of Grant UK Ltd. Frankland Road, Blagrove Industrial Estate, Swindon, SN5 8YG, tel: 01380 736920</small>	